



**INSTRUCTION MANUAL FOR  
SAMSON LIQUID RING PUMPS, TYPES:  
KL350, KL400, KL430, KL500**



---

# CONTENTS

<b>1</b>	<b>Introduction .....</b>	<b>4</b>
1.1	Declaration of conformity .....	4
1.2	Explanation of warning symbols.....	5
1.3	Marking and identification .....	5
1.4	Field of application .....	6
1.5	Disposal .....	6
<b>2</b>	<b>Technical data.....</b>	<b>7</b>
2.1	Dimensions .....	7
2.2	Specifications .....	8
2.3	Power consumption and output.....	9
2.3.1	Vacuum .....	9
2.3.2	Pressure.....	10
2.3.3	Correction factor.....	11
2.4	Handling and transport.....	11
2.5	Pump storage.....	12
2.6	Materials .....	13
<b>3</b>	<b>Design of the systems .....</b>	<b>15</b>
3.1	The pump's function.....	15
3.2	System layout example .....	16
3.3	Liquid separator .....	17
3.4	Cooling system.....	18
3.4.1	KL350 - Vacuum.....	20
3.4.2	KL350 - Pressure .....	21
3.4.3	KL400 - Vacuum.....	22
3.4.4	KL430 - Vacuum.....	23
3.4.5	KL430 - Pressure .....	24
3.4.6	KL500 - Vacuum.....	25
3.5	Pipe system.....	26
3.6	Service liquid requirements.....	26

---

<b>4</b>	<b>Installation and start-up.....</b>	<b>27</b>
4.1	Securing the pump .....	27
4.2	Connections to the pump .....	27
4.3	Connecting the service liquid .....	28
4.4	Transmission .....	28
4.5	Prior to start-up .....	29
4.6	Direction of rotation .....	29
<b>5</b>	<b>Recommended service, maintenance and inspection intervals .....</b>	<b>30</b>
5.1	Draining the liquid separator .....	30
5.2	Check grease cartridges .....	30
5.3	Lubrication of bearings.....	30
5.4	Inspection and cleaning of service liquid's supply pipe .....	30
<b>6</b>	<b>Troubleshooting .....</b>	<b>31</b>
<b>7</b>	<b>Spare parts.....</b>	<b>32</b>

# 1 INTRODUCTION

## 1.1 Declaration of conformity



### Declaration of Conformity

Annex IIA

**Samson Pumps A / S**  
Petersmindevej 21  
DK-8800 Viborg

Hereby declares that the following products:

**Liquid ring pump**  
**KL350, KL400, KL430, KL500**

Conforms to the directive:


**Machinery Directive 2006/42/EC**

I hereby declare, that the liquid ring pumps are in conformity with the following harmonized standards:

DS/EN ISO 12100:2011	Safety of machinery - General principles for design - Risk assessment and risk reduction
DS/EN 1012-2 + A1:2009	Compressors and Pumps - Safety requirements - Part 2: Vacuum pumps

The standards above only apply to the extent that it is relevant for the purpose of the pump. The product must not be used before the complete system, which it must be incorporated in, has been conformity assessed and found to comply with all relevant health and safety requirements of 2006/42/EC and other relevant directives. The product must be included in the overall risk assessment.

Viborg, 09.03.2017

  
Kelvin Storm Jensen  
R&D Manager  
Samson Pumps A/S

DOC4019A

Email   <a href="mailto:info@samson-pumps.com">info@samson-pumps.com</a>	Samson Pumps A/S	Petersmindevej 21
Web   <a href="http://www.samson-pumps.com">www.samson-pumps.com</a>	Phone   +45 87 50 95 70	DK-8800 Viborg

## 1.2 Explanation of warning symbols


Important technical and safety instructions is showed by symbols. If instructions not performed correctly, may lead to personnel injury or incorrect function of the pump.



To be used with all safety instructions that must be followed. A failure to follow the instructions may result in injury and/or incorrect machine operation.

## 1.3 Marking and identification


The pump is equipped with an identification plate that is shown below.

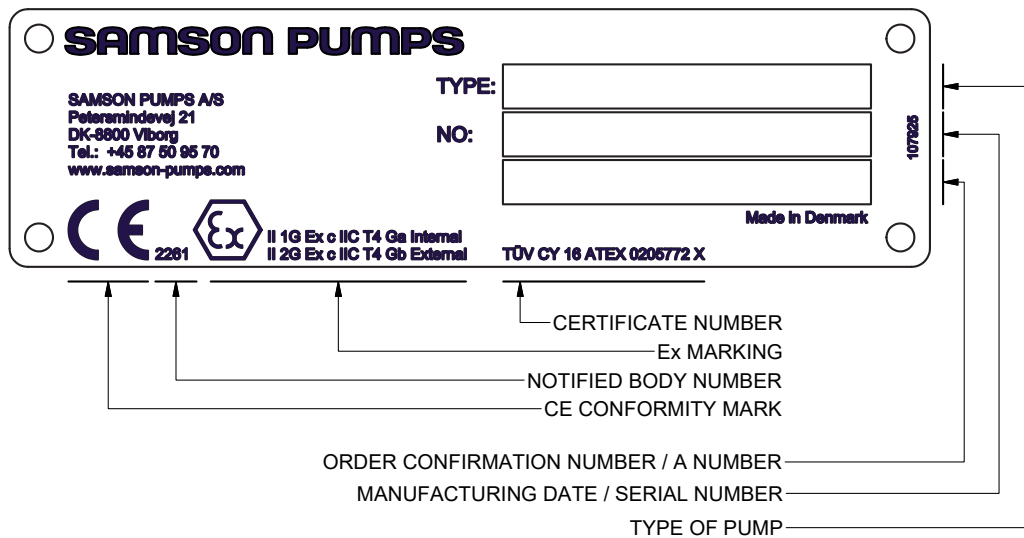

Configuration example:

**KL 350 R 0 S S E 0 0 A X1**

- Type: ←
- Model: ←
- Rotation: ←
- Rotor type: ←
- Pump housing: ←
- Shell: ←
- Flow plates: ←
- Mechanical shaft seals: ←
- Gaskets: ←
- Colour: ←
- Documentation: ←



Location of ID plate

DOC107925\_6

---

## 1.4 Field of application



Inlet of foreign objects can damage the pump.



The pump is designed exclusively to pump gases, including atmospheric air.



**WARNING!**  
Do not operate the pump so that cavitation can occur! For further information see instruction manual for the Samson Pumps vacuum limiter.

It must be ensured that the inlet gas cannot react with the service liquid and create aggressive bonds that break down the pump's components.

For other operating data, see specifications.

- The pump may only be used with media that are not aggressive to the pump's materials. See section 2.6 for components and appertaining materials.

## 1.5 Disposal

Samson's liquid ring pump is manufactured so that most of the device can be reused/recycled.


Samson Pumps thus offer users of the company's pumps the option of returning used pumps to be restored or scrapped.

For those who do not wish to take up the factory on this offer, the pump must be taken apart and sorted into its separate components. See section 2.6 for the material of which the pump is made.

These components must be disposed of in accordance with national regulations.

# 2 TECHNICAL DATA

## 2.1 Dimensions

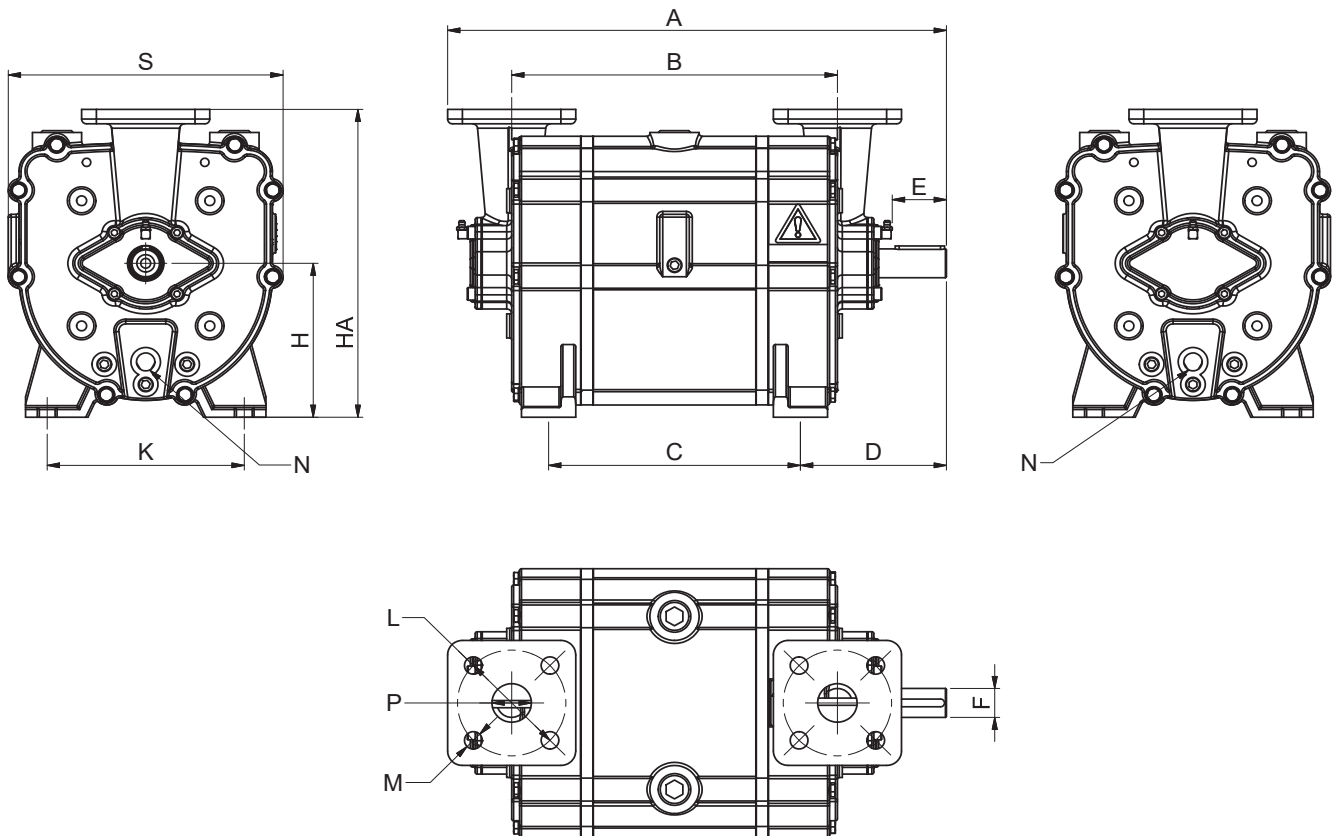

DOC1627289\_2A

Dimensions [mm]															
Pump type	A	B	C	D	E	F	H	HA	K	L	M	N	P	S	Weight [kg]
<b>KL350</b>	542	375	305	136.5	60	Ø30/k6	180	350	240	Ø125	Ø18	½"	Ø50	320	100
<b>KL400</b>	542	375	305	136.5	60	Ø30/k6	180	350	240	Ø125	Ø18	½"	Ø50	320	100
<b>KL430</b>	602	436	366	136.5	60	Ø30/k6	180	350	240	Ø125	Ø18	½"	Ø50	320	117
<b>KL500</b>	602	436	366	136.5	60	Ø30/k6	180	350	240	Ø125	Ø18	½"	Ø50	320	117

## 2.2 Specifications



A failure to meet these specifications may result in damage to the pump.

Description		Minimum	Maximum
Ambient temperature, operation		-20°C	55°C
Ambient temperature, storage		-20°C	55°C
Humidity		-	80%
Intake temperature, suction side		-	120°C
Intake temperature, service liquid		-	90°C
Service liquid pipe connection, dimension		1/2"	-
Service liquid pipe connection, length		-	6 m
Noise level		-	70 dB
Maximum radial load on drive shaft	KL350	-	1800 N
	KL400	-	
	KL430	-	1250 N
	KL500	-	
Revolutions		1200 rpm	1750 rpm
Pressure		33 mbara	2.5 barg
Service liquid flow		3 litres/minute, self-regulating*	
Lubricating grease	Type of grease	SKF LGWA2	
	Automatic lubrication	SKF LAGD 125/WA2	

\* -It is recommended to install liquid separator to ensure the pump is supplied with as much water as needed.



## 2.3 Power consumption and output

### 2.3.1 Vacuum

#### KL350

	Pressure	[mbara]	33	100	200	300	400	500	600	700	800
1200 [rpm]	Flow	[m <sup>3</sup> /h]	-	150	215	232	250	259	264	269	274
	Consumption	[kW]	-	6.2	8.1	8.9	8.9	8.6	8.1	7.5	6.8
1450 [rpm]	Flow	[m <sup>3</sup> /h]	-	212	277	300	318	323	326	331	336
	Consumption	[kW]	-	8.8	10.5	11.4	11.4	11.1	10.6	10	9.3
1750 [rpm]	Flow	[m <sup>3</sup> /h]	-	275	345	368	380	390	395	397.5	401
	Consumption	[kW]	-	12	13.7	14.6	14.6	14.2	13.7	13.2	12.5

#### KL400

1200 [rpm]	Flow	[m <sup>3</sup> /h]	20	286	318	327	333	337	337	336	333
	Consumption	[kW]	4.5	6.3	8.1	8.9	8.9	8.7	8.2	7.5	6.8
1450 [rpm]	Flow	[m <sup>3</sup> /h]	50	364	413	425	431	434	435	435	430
	Consumption	[kW]	6.7	8.8	10.6	11.4	11.5	11.2	10.6	10	9.4
1750 [rpm]	Flow	[m <sup>3</sup> /h]	70	415	485	499	505	507	509	508	504
	Consumption	[kW]	10	12	13.6	14.6	14.6	14.4	13.7	13.2	12.5

#### KL430

1200 [rpm]	Flow	[m <sup>3</sup> /h]	-	65	210	280	315	326	336	345	351
	Consumption	[kW]	-	8.8	10	11.2	11.8	11.3	10.8	9.8	8.9
1450 [rpm]	Flow	[m <sup>3</sup> /h]	-	212	329	378	410	425	429	434	437
	Consumption	[kW]	-	11.7	12.8	14.3	15.2	15.3	14.8	14	13.1
1750 [rpm]	Flow	[m <sup>3</sup> /h]	-	325	452	480	500	513	523	528	533
	Consumption	[kW]	-	17.5	18.8	20.1	21	21.1	20.5	19.7	18.8

#### KL500

1200 [rpm]	Flow	[m <sup>3</sup> /h]	120	268	313	333	352	363	368	367	365
	Consumption	[kW]	10.7	11.5	12.4	12.9	13	12.8	12.5	11.9	11.2
1450 [rpm]	Flow	[m <sup>3</sup> /h]	125	410	430	440	450	459	465	466	461
	Consumption	[kW]	12.3	13.2	14.3	14.9	15	14.9	14.5	13.9	13.3
1750 [rpm]	Flow	[m <sup>3</sup> /h]	130	518	540	550	560	568	574	574	570
	Consumption	[kW]	14.5	15.6	16.8	17.4	17.5	17.4	17	16.5	15.8

The data is based on the following parameters:

- Air temperature 20°C
- Service liquid temperature 15°C
- Test performed with dry air and 1,013 mbar absolute.
- Tolerance ±10%

## 2.3.2 Pressure

### KL350

	Press. [barg]	0.3	0.4	0.5	0.6	0.7	0.8	0.9	1	1.1	1.2	1.3	1.4	1.5	2	2.5
1200 [rpm]	Flow [m <sup>3</sup> /h]	270	260	240	220	195	170	135	105	70	40	-	-	-	-	-
	Cons. [kW]	8.2	8.8	9.3	9.9	10.5	11	11.6	12.1	13	15	-	-	-	-	-
1450 [rpm]	Flow [m <sup>3</sup> /h]	335	330	320	315	305	285	280	265	240	225	200	185	168	35	-
	Cons. [kW]	10	10.8	11.4	12.1	12.9	13.5	14.2	15	16	17	17.5	18	18.5	22	-
1750 [rpm]	Flow [m <sup>3</sup> /h]	411	409	406	403	400	395	385	380	375	365	355	345	335	240	-
	Cons. [kW]	16.2	17.1	18	18.9	19.8	20.7	21.6	22.4	23.5	24.5	25.5	26.5	27	31.5	-

### KL430

1200 [rpm]	Flow [m <sup>3</sup> /h]	333	330	298	265	220	166	114	70	40	20	-	-	-	-	-
	Cons. [kW]	9.8	10.1	10.3	10.8	10.9	11.1	11.4	11.8	12.5	13	-	-	-	-	-
1450 [rpm]	Flow [m <sup>3</sup> /h]	440	435	422	402	370	330	292	255	210	170	130	100	70	-	-
	Cons. [kW]	14.9	15.2	15.7	16	16.4	16.9	17.1	17.6	18	18.2	18.5	19	19.5	-	-
1750 [rpm]	Flow [m <sup>3</sup> /h]	560	560	559	549	535	522	510	492	465	430	395	360	330	160	70
	Cons. [kW]	24.3	25	25.7	26.3	27	27.6	28.2	28.9	29	30	31	31.5	32	36.5	39

The data is based on the following parameters:

- Air temperature 20°C
- Service liquid temperature 15°C
- Test performed with dry air and 1,013 mbar absolute.
- Tolerance ±10%


### 2.3.3 Correction factor

When the temperature of the service liquid exceeds 15°C, the pump's capacity will be affected with respect to the specified values.

To determine the output at a higher temperature, the correction factor can be used.

Capacity at service liquid temperature higher than 15°C :

$$Q_{>15} = Q_{15} \times K_1$$

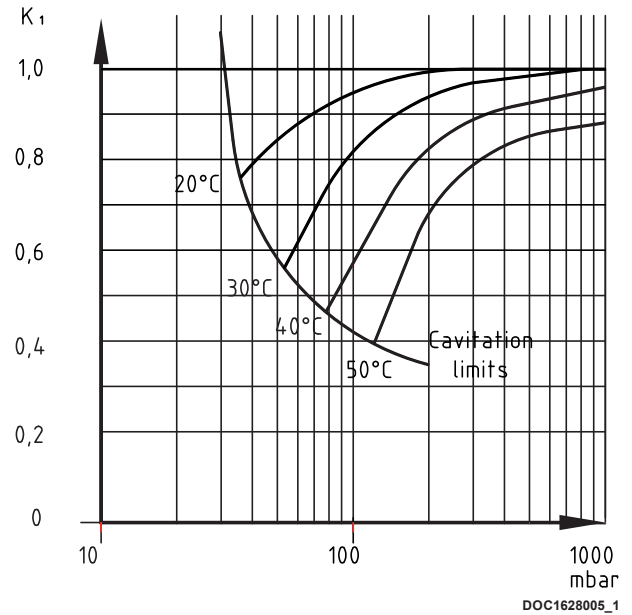

### 2.4 Handling and transport




The pump may not be used if it is damaged or the identification plate is missing!

The pump must be transported in such way that is not exposed to vibrations and impacts that can overload the bearings.


The pump must be inspected for damages upon delivery. If the pump is damaged, it may not be used and the damage must be reported to the dealer.

Ensure that the pump's identification plate is intact and that the marking of the pump corresponds to its use.

The pump may only be handled using approved lifting eyes, in accordance with nationally applicable regulations and only in a vertical motion.

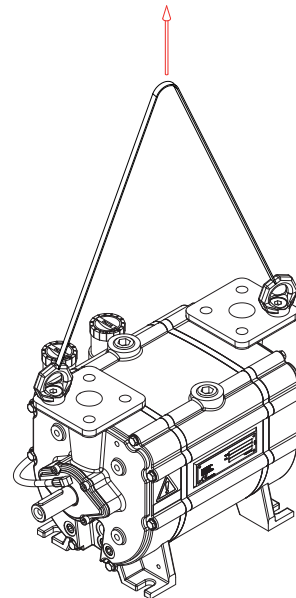

The pump can be transported in the following ways:



DOC11093A

## 2.5 Pump storage



A failure to comply with the requirements for storing the pump may result in internal damage to the device.



If the temperature is below freezing point of the service liquid, it may damage the pump. Under these conditions the pump must be drained completely.



All plugs and protective covers must be fitted during storage.


The pump's service liquid is drained on delivery, and the pump can be immediately stored in accordance with the technical specifications.

After operation, the pump can be stored for 30 days without further action.

If the pump remains out of operation for a longer period of time after use, its service liquid must be drained, and the liquid supply to the pump must be shut off.

When emptying the pump, it is important that all compartments inside the pump are emptied.

The pump can be fitted with valves in the draining connections. See below.

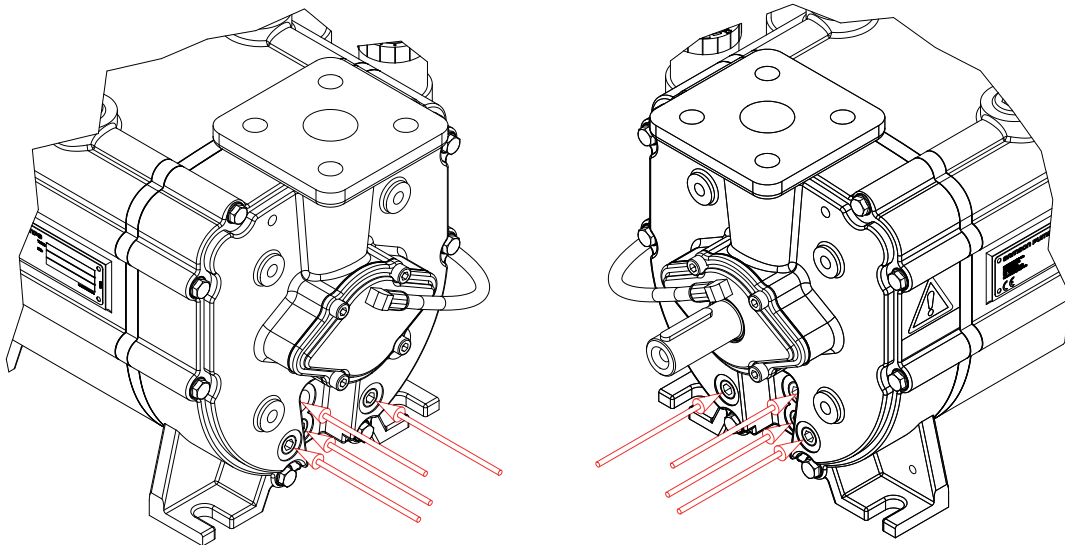


DOC1627287B

## 2.6 Materials

Term	Pos.	Material	Description
Bearing cover	1	Cast iron	EN-GJL-250; EN1561
Radial shaft seal	2	Rubber	Type CB NBR; DIN 3760A
Rubber gasket	3	Rubber	NBR 70
Ball bearing	4	Chrome steel	W.Nr.1.3505
Radial shaft seal	5	Rubber	Type CB NBR; DIN 3760A
Adjustment plate	6	Cast iron	EN-GJL-250; EN1561
Ball guide	7	Polyethylene	PEHD 1000
Valve balls	8	Polypropylene	PPH100NA-20M Anti-static
Spacer for ball guide	9	Stainless steel	W.Nr.1.4401
Flexible tube for automatic lubricator**	10	Polyamide	PA6
Push-in nipple**	11	Brass	-
Push-in nipple**	12	Brass	-
Fitting**	13	Brass	-
Clamp for automatic lubricator**	14	Polyamide	PA6
Automatic lubricator LAGD 125/WA2**	15	Polyamide	PA6
Threaded plug	16	Steel	1.067; DIN 906
O-ring	17	Rubber	NBR 70; DIN 3771
Pump housing	18	Cast iron	EN-GJL-250; EN1561
Paper gasket	19	Paper	Oakenstrong
Mechanical shaft seal	20	NBR / AISI / Carbon	-
Flow plate*	21	Stainless steel	W.Nr.1.4401
		Cast iron	EN-GJL-250; EN1561
Paper gasket	22	Paper	Oakenstrong
Rotor	23	Steel	W.Nr.1.4418 / 1.4404
Shell	24	Cast iron	EN-GJL-250; EN1561
Identification plate	25	Stainless steel	AISI 316

\* -See section 1.3 for configuration of pump.

\*\*-Optional. Not equipped as standard.

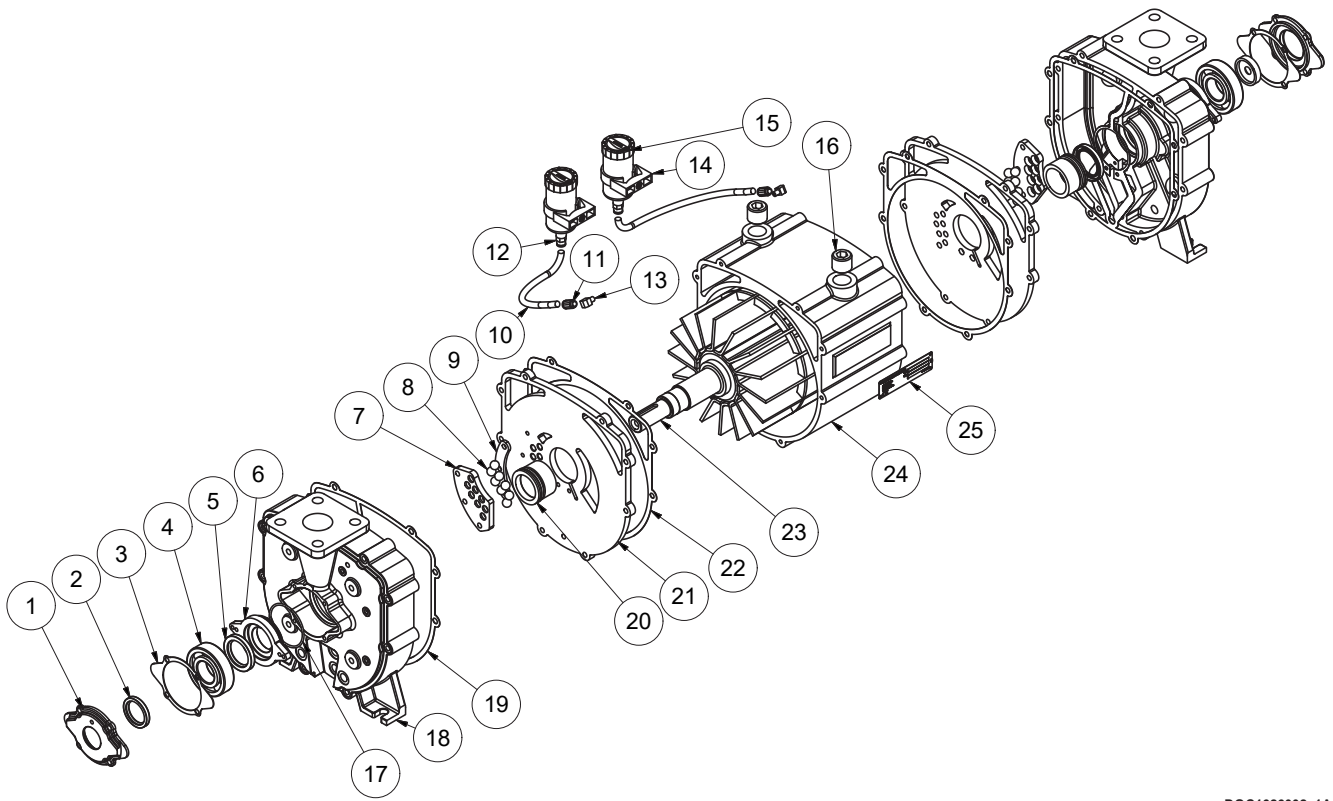


DOC1626002\_1A

---

# 3 DESIGN OF THE SYSTEMS

## 3.1 The pump's function

As the name suggests, the pump works with a liquid ring. There is no mechanical contact between the moving parts, and the liquid works like small pistons that, in principle, function as a traditional piston pump.

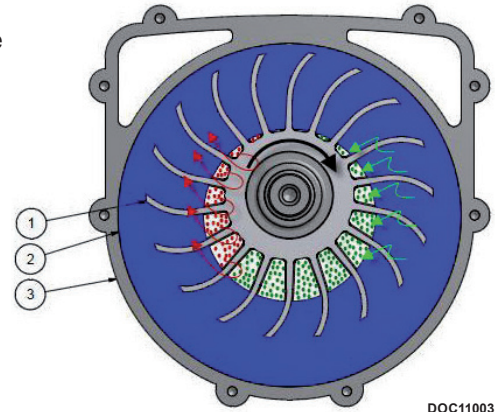

When the pump is started, the liquid ring will rotate at the same speed as the rotor. The rotor is positioned slightly higher than the centre point and divides the liquid ring up into cells. If one were to see the cell in the top position, it would be completely filled with liquid.

As the cell rotates, an air space is created against the hub of the rotor. The liquid moves like a piston away from the hub of the rotor and thereby creates a suction effect. As the cell reaches the bottom, the movement changes direction and causes the service liquid to be pushed in towards the hub of the rotor. The air is thus pushed out of the cell, which becomes completely filled with liquid and ready for a new suction cycle. In order to separate the suction and pressure sides of the pump, the ends of the shell are fitted with a flow plate and pump housing. Some pump types have connections at both ends, while others – known as monoblock pumps – only have a connection on one end of the liquid ring.

A certain volume of the service liquid and gas will flow out of the pump. The pump must therefore be constantly supplied with new service liquid.

In addition to replacing any lost liquid, the new liquid supply will cool the compressor gas in the pump and lubricate the mechanical shaft seals.


The composition and correct addition of service liquid are essential to the functioning of the pump. See section 3 on the liquid composition.

## 3.2 System layout example



- The product does not get sucked into the system, by installing of suitable level transmitter.
- The maximum working pressure does not exceed specifications, by installing a safety valve.

The liquid ring pump can be integrated in a system which takes advantage of both sides of the pump, vacuum and pressure. The example on illustrates the pump installed with a 4-way valve and a product tank. The 4-way valve, depending on position, will fill the tank by vacuum or empty the tank by pressure.

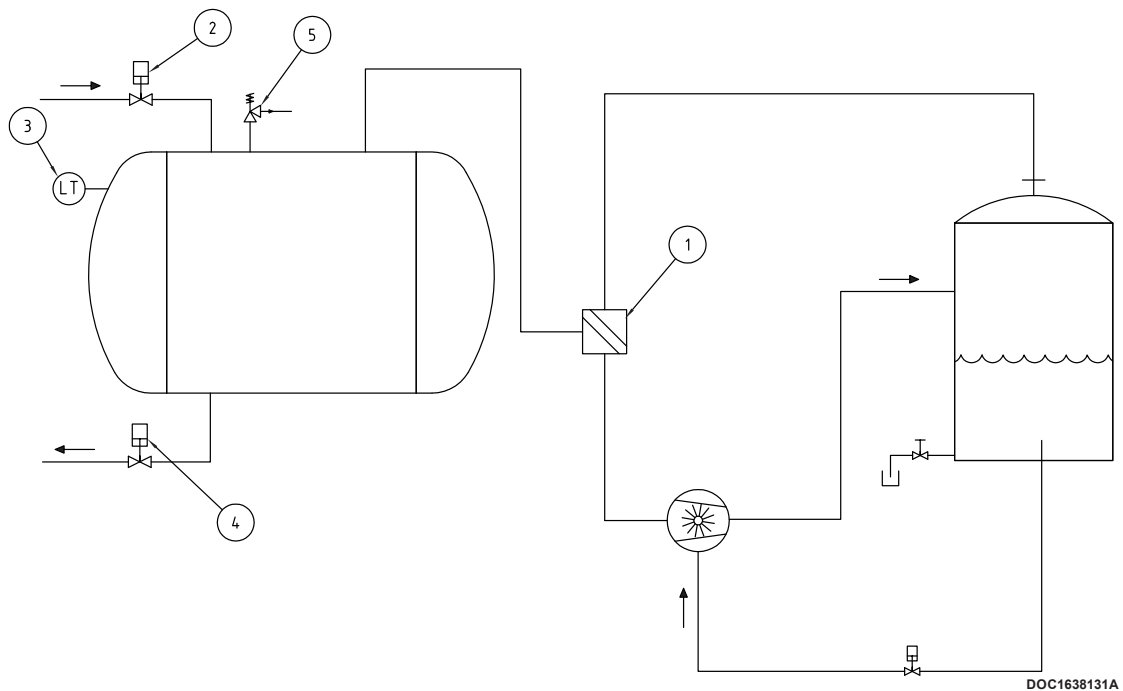

Pos.	Description
1	4-way valve
2	Suction valve
3	Level transmitter
4	Discharge valve
5	Safety valve



---

### 3.3 Liquid separator



Liquid separator is mounted in such way that the minimum level of service liquid is minimum 0,5 m above the pump's shaft.

To prevent calcium deposits, use a liquid separator or take necessary measures to prevent calcium in the service liquid.

The liquid separator is located in immediate proximity to the pump, so that the length of the outlet pipe from the pump is minimised.

Due to potential pressure loss, the length may not exceed 2 metres. The level of liquid in the liquid separator is recommended to be kept at 1-1.5 metres above the pump's shaft. This ensures the correct influx pressure and the correct flow of service liquid.

The liquid supply between the liquid separator and pump must be implemented with a permanent pipe connection with a dimension and length specified in specifications.

It may be advantageous to fit the liquid separator with a float valve, which automatically supplies liquid and maintains a constant level.

The liquid separator can be fitted with a drain valve at the lowest place in the tank. The valve can be operated when the separator needs to be drained to remove contaminants.


### 3.4 Cooling system

The compression in the pump generates heat, which will cause the temperature of the service liquid to rise. This means that it will often be necessary to cool the liquid. This can be done using an air cooler or heat exchanger. For short-term operation with intermittent breaks, natural cooling may be sufficient.

Depending on the temperature, the suctioned gas may be sufficient for cooling purposes, though it may also lead to an increased need for cooling.

The necessary cooling requirement can be found in chapters 3.4.1 to 3.4.6

Delta T ( $\Delta t$ ) is the temperature difference between the suctioned gas ( $T_1$ ) and the maximum acceptable service liquid temperature ( $T_2$ ). See below.

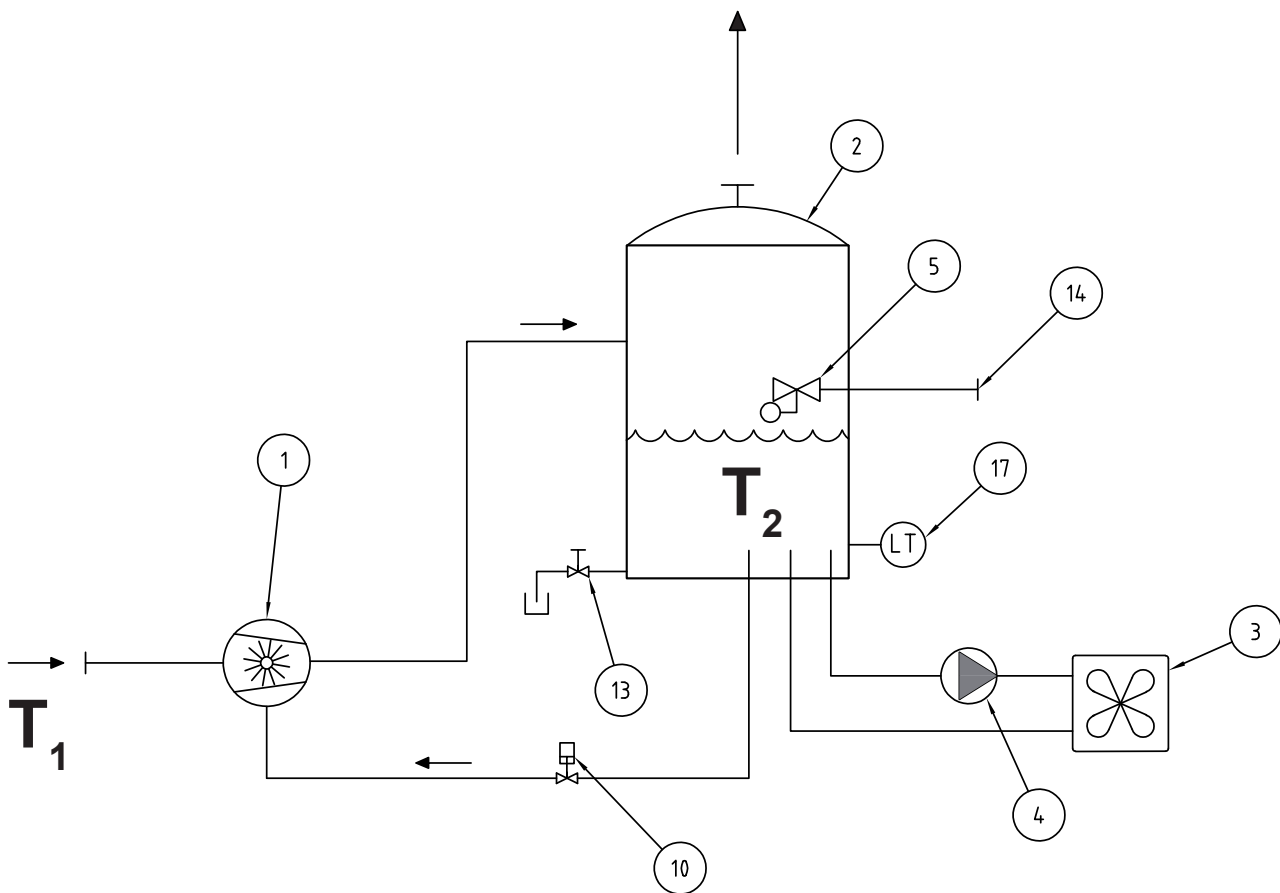

1638149

Pos.	Description
1	Vacuum pump
2	Liquid separator
3	Cooler
4	Circulation pump
5	Float valve
10	Stop valve
13	Drain valve
14	Service liquid connection
17	Level transmitter

**Example 1:** The intake temperature is 5°C, and the desired maximum service liquid temperature is 45°C.


$$\Delta t = 5 - 45 = -40^\circ\text{C}.$$

The cooling requirement at a pressure of 550 mbara will be 3 kW. See below.

**Example 2:** The intake temperature is 60°C, and the desired maximum service liquid temperature is 30°C.


$$\Delta t = 60 - 30 = 30^\circ\text{C}.$$

The cooling requirement at a pressure of 700 mbara will be 4.8 kW. See below.

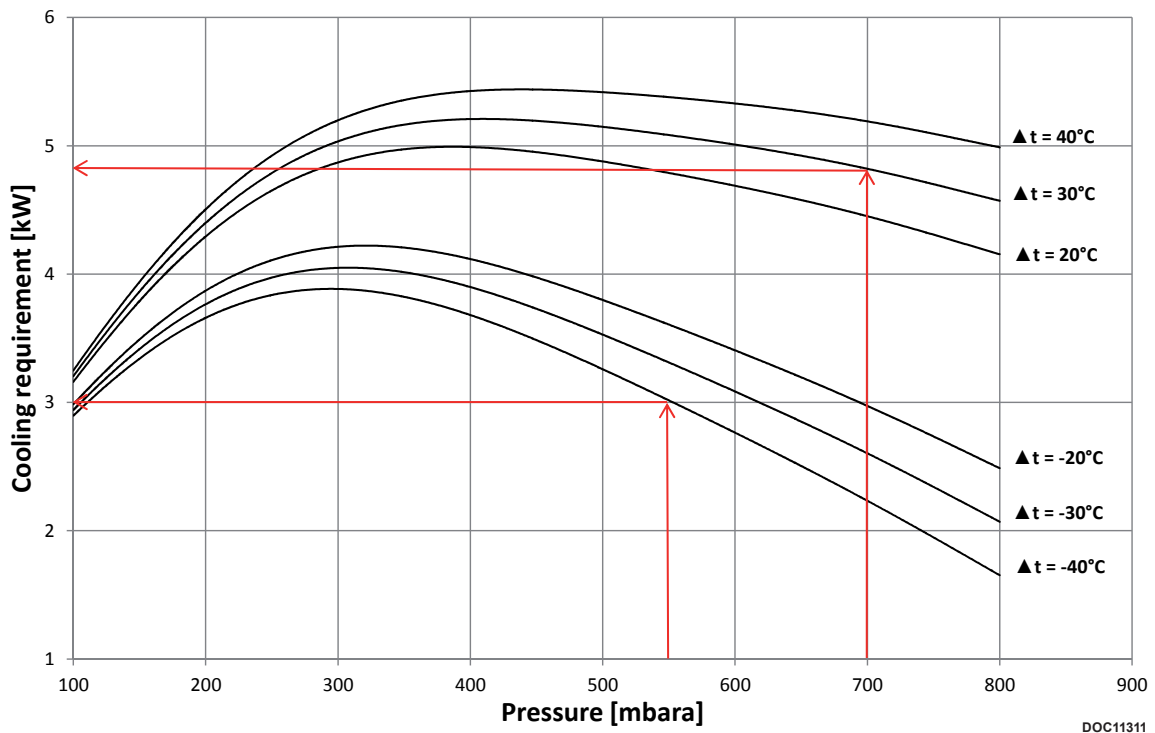


### 3.4.1 KL350 - Vacuum


KL350 - 1200 rpm - Vacuum

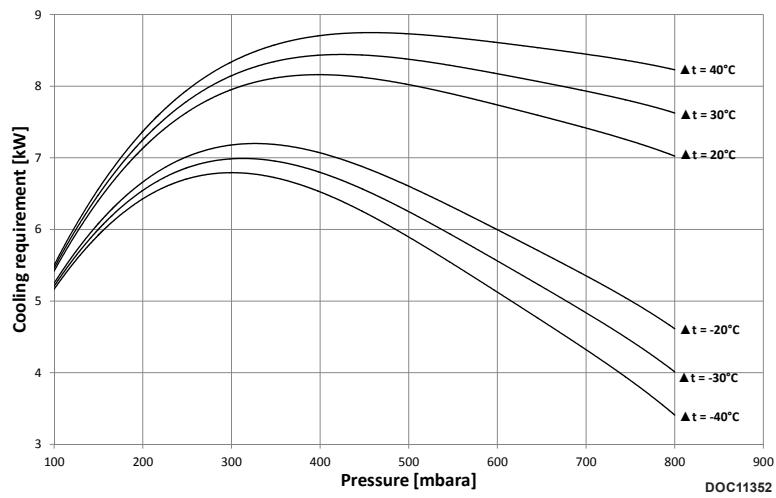

KL350 - 1450 rpm - Vacuum

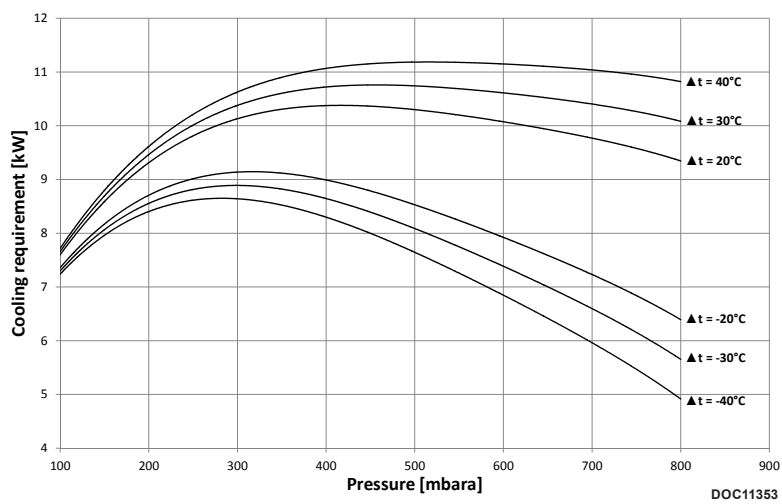


KL350 - 1750 rpm - Vacuum

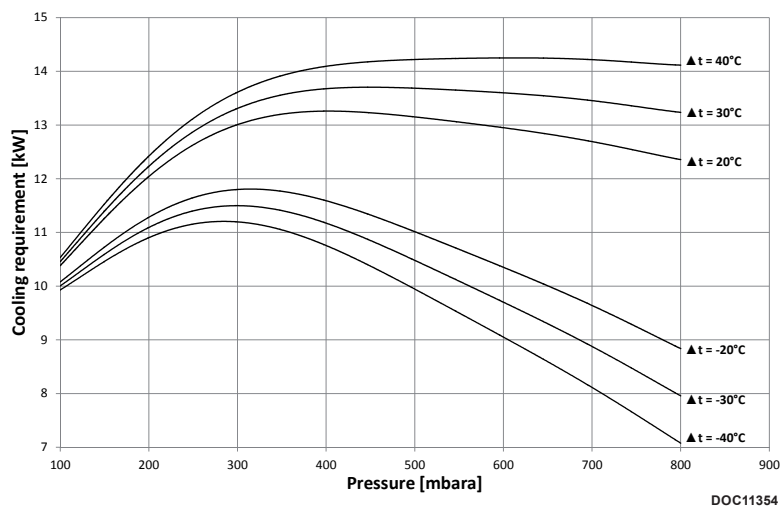


### 3.4.2 KL350 - Pressure


KL350 - 1200 rpm - Pressure

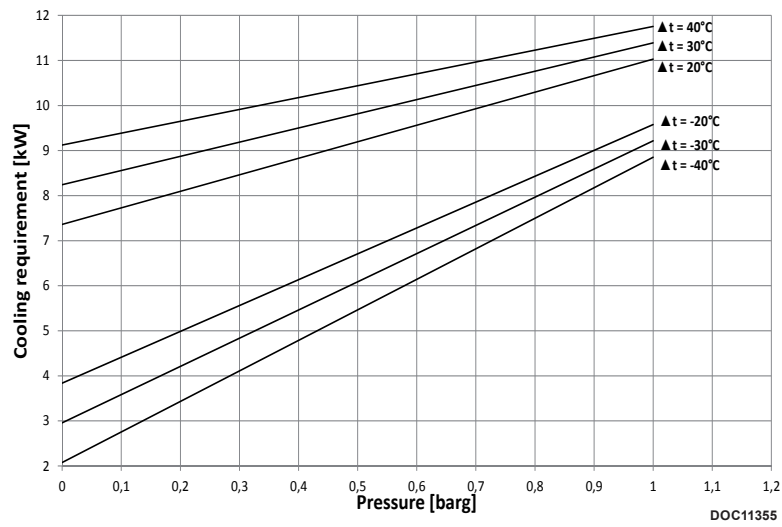

KL350 - 1450 rpm - Pressure

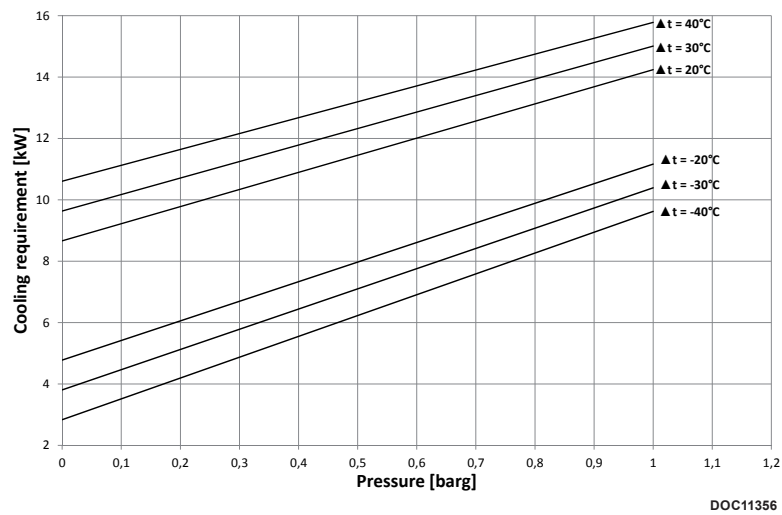


KL350 - 1750 rpm - Pressure

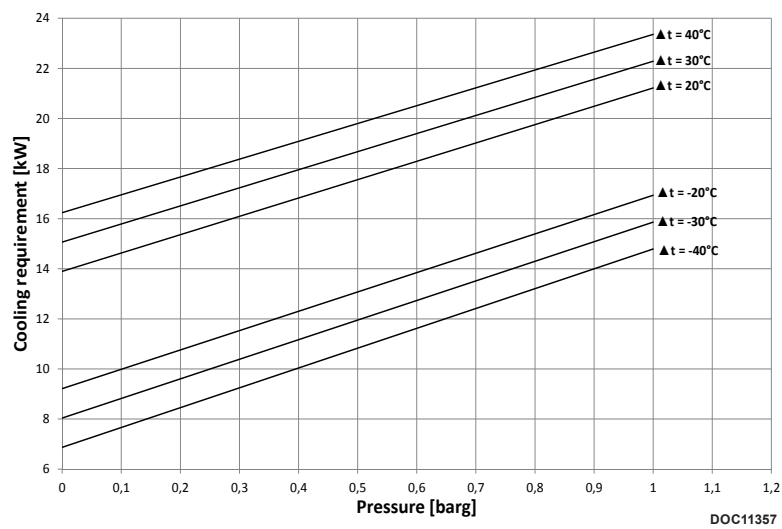


### 3.4.3 KL400 - Vacuum


KL400 - 1200 rpm - Vacuum

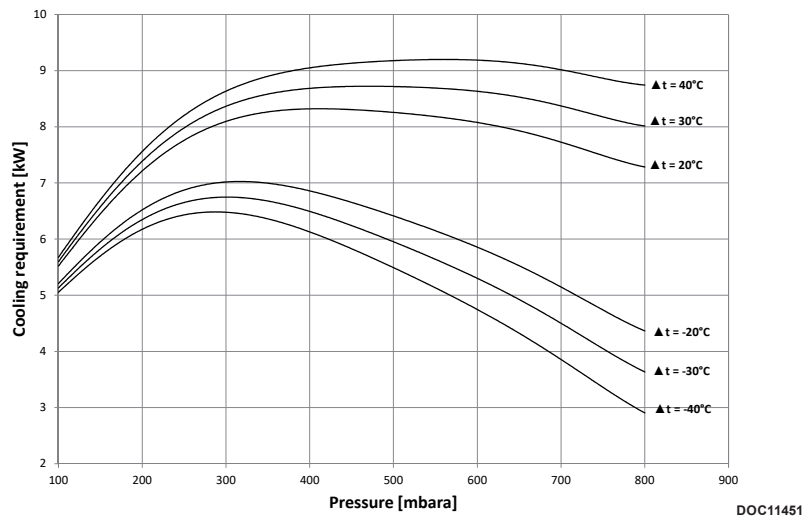

KL400 - 1450 rpm - Vacuum

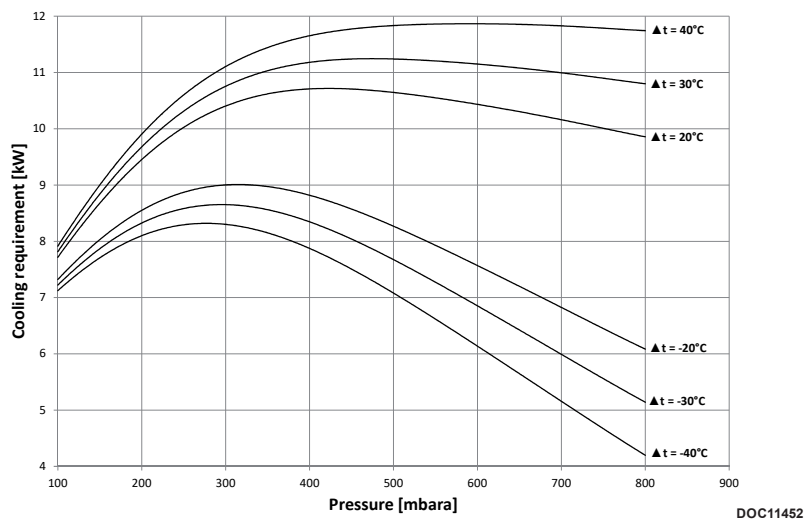


KL400 - 1750 rpm - Vacuum

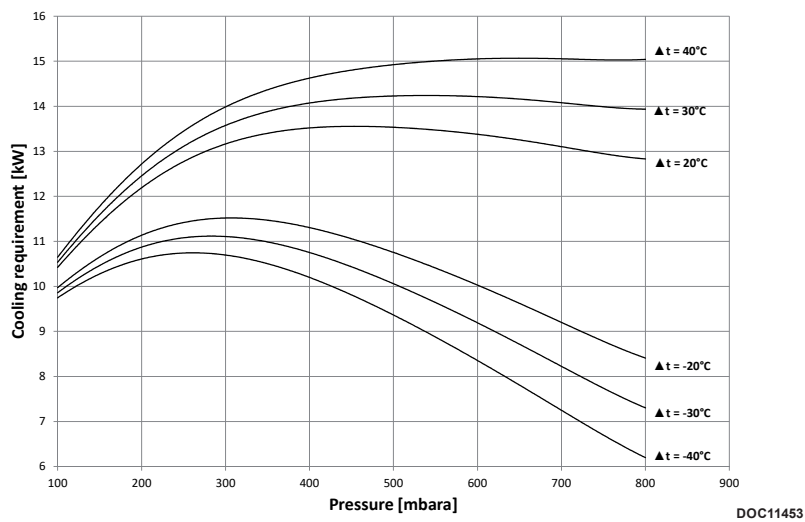


### 3.4.4 KL430 - Vacuum


KL430 - 1200 rpm - Vacuum

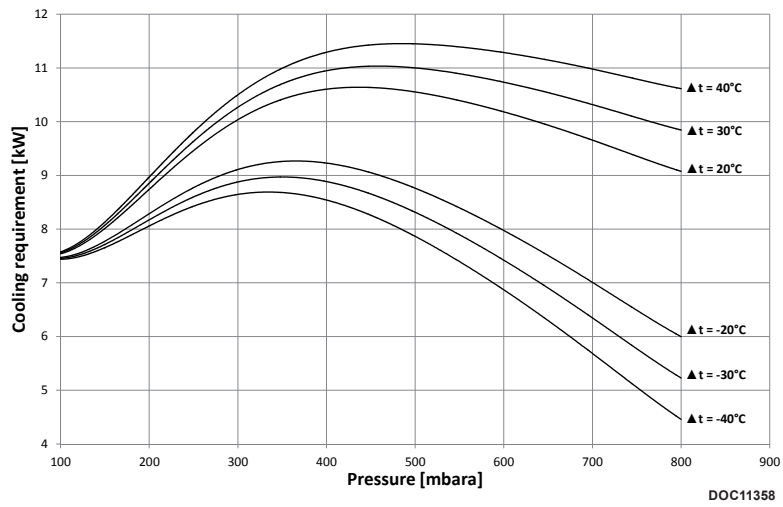

KL430 - 1450 rpm - Vacuum

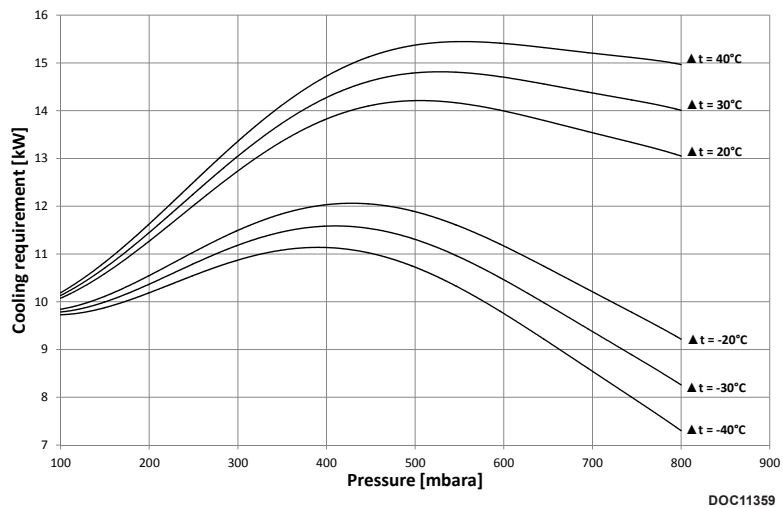


KL430 - 1750 rpm - Vacuum

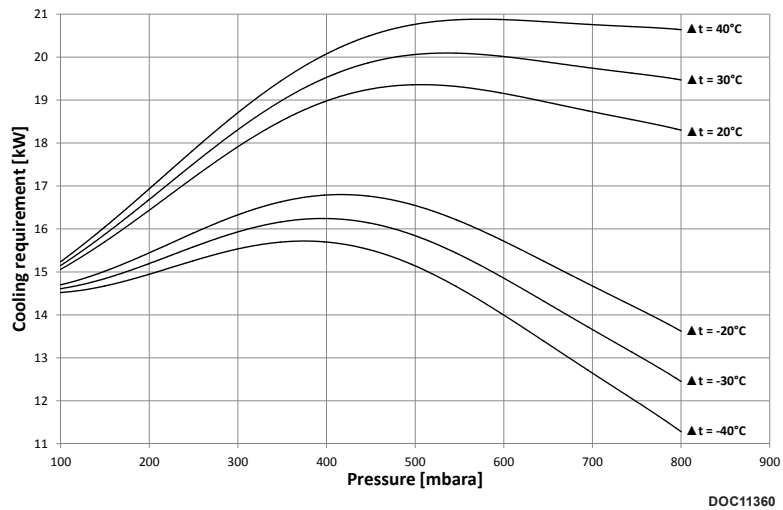


### 3.4.5 KL430 - Pressure


KL430 - 1200 rpm - Pressure

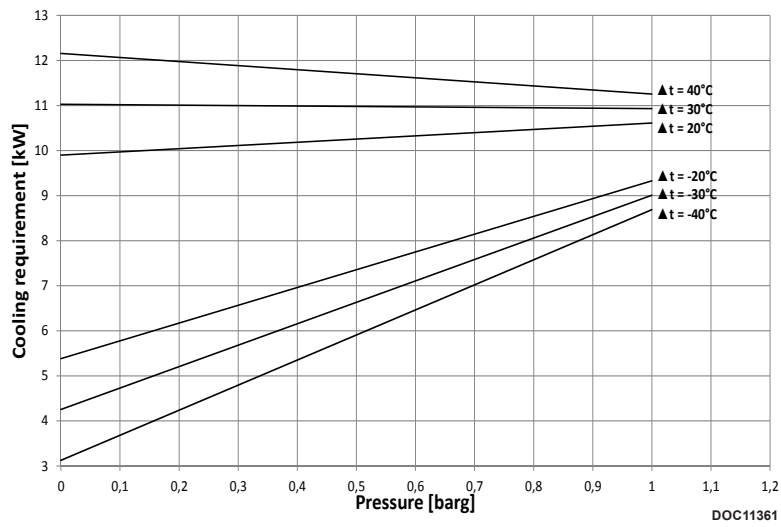

KL430 - 1450 rpm - Pressure

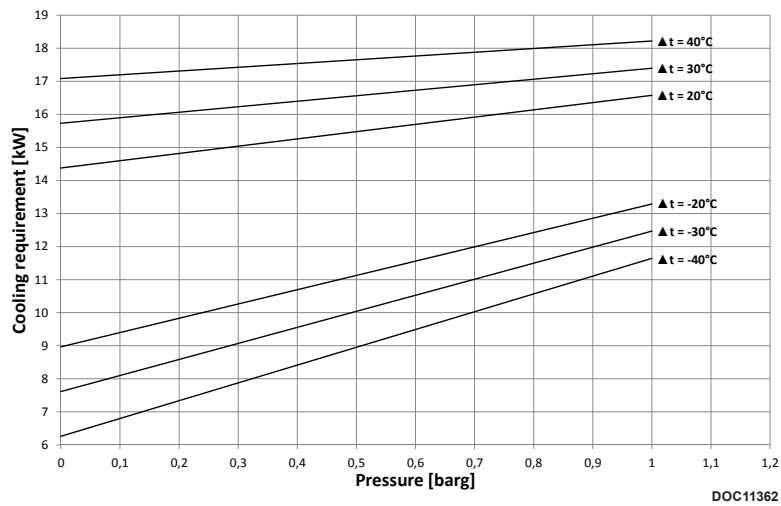


KL430 - 1750 rpm - Pressure

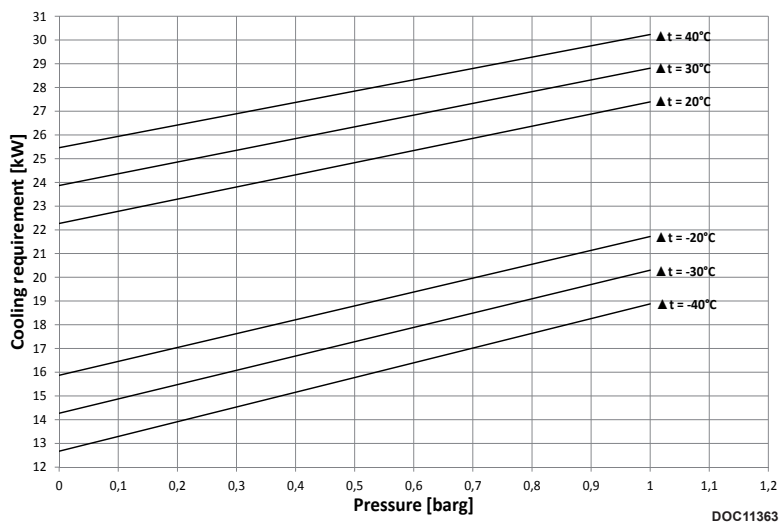




### 3.4.6 KL500 - Vacuum


KL500 - 1200 rpm - Vacuum

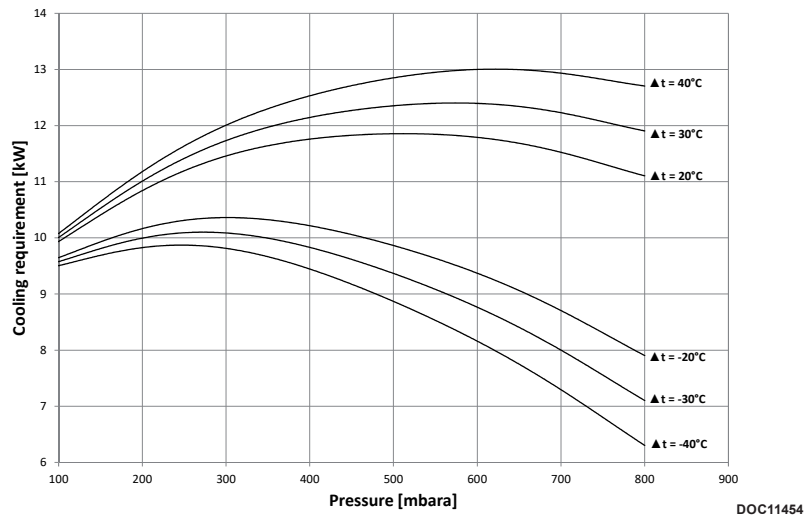

KL500 - 1450 rpm - Vacuum

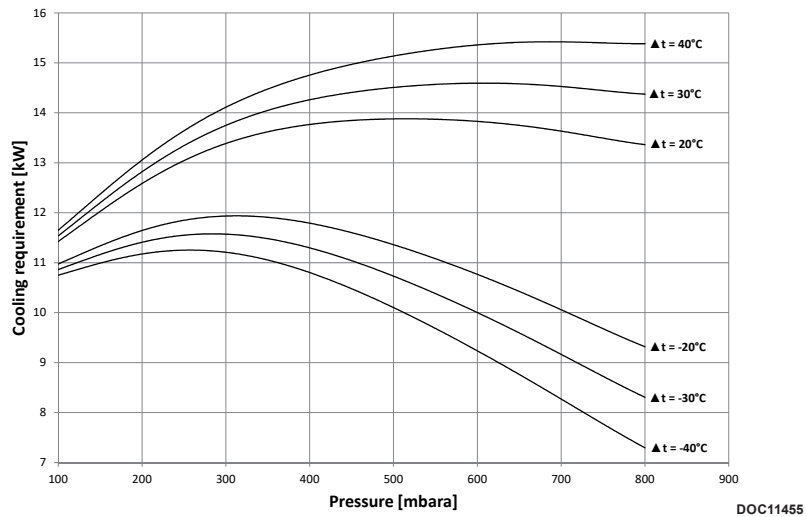

KL500 - 1750 rpm - Vacuum

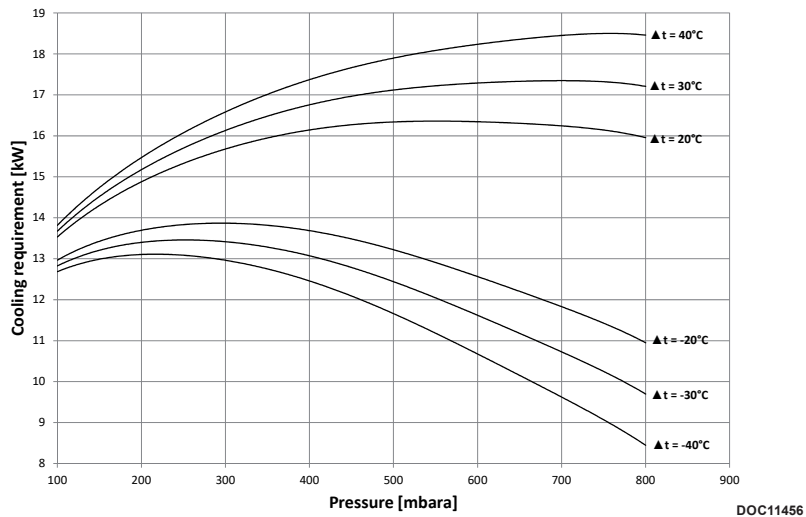

---

### 3.5 Pipe system

The pipes that are connected to the pump's suction and outlet sides must be at least the same dimension as the pump. The length of the pipe system affects the pump's capacity and should be calculated to account for pressure drop in longer pipe installations.

Depending on the operating pressure, longer pipe lengths may affect the pump's output. For pipe lengths greater than 10 metres, a pressure drop calculation should be made, and the pipe dimensions should be increased so that the pressure loss is held to an acceptable level.

The pipe system should be mounted so that the horizontal pipes have a min. of 1% decline back towards the liquid separator.

Table below can be used for reference values.

Connection	Length < 10 metres	Length 10-50 metres	Length 50-100 metres
Suction side	Min. DN 50	Min. DN 65	Min. DN 100
Outlet side	Min. DN 50	Min. DN 65	Min. DN 100

The outlet from the liquid separator should be led outside of the building, because the outlet air is warm and humid.

With respect to the exhaust, measures must be put in place to account for damp air that may form ice in cold surroundings.

### 3.6 Service liquid requirements

Only water-based liquid may be used as service liquid.

For operating conditions where there is a risk of ice formation in the service liquid system, a suitable anti-freeze must be used.

# 4 INSTALLATION AND START-UP


## 4.1 Securing the pump



If the tolerance for securing the pump is not observed, there is a risk of damage.

The pump must be installed on a stable foundation, which must be level and stable, so that the pump is not twisted or exposed profile distortion.

The pump must be anchored with M12 foundation bolts on all four legs, which must be tightened to 60 Nm. (A)

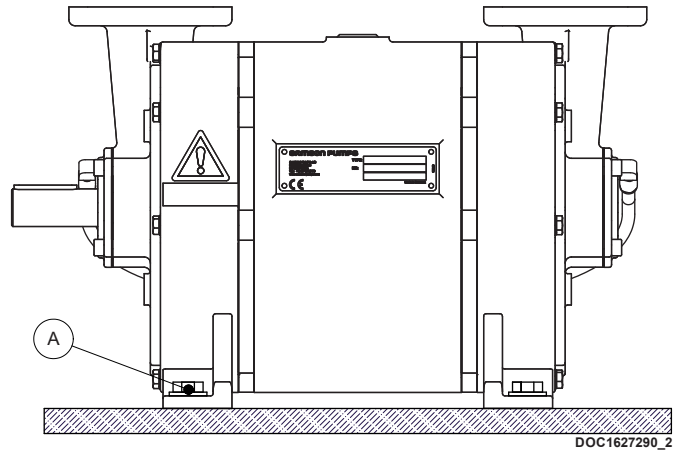

DOC1627290\_2

## 4.2 Connections to the pump




- Check for foreign objects in the pump and physical damage on pump.
- Gaskets to be handled with highest degree of caution.
- Gasket and sealing surfaces must be cleaned before assembly.

Immediate before connecting the pipes, remove protective covers. Connection of the pump's suction and pressure pipe connections must be made with a gasket in between. (C)

The M12 bolts must be tightened to 60 Nm. (B)

In order to prevent tensions in the pump, the pipe connections (A) must be tensionless while tightening the bolts.

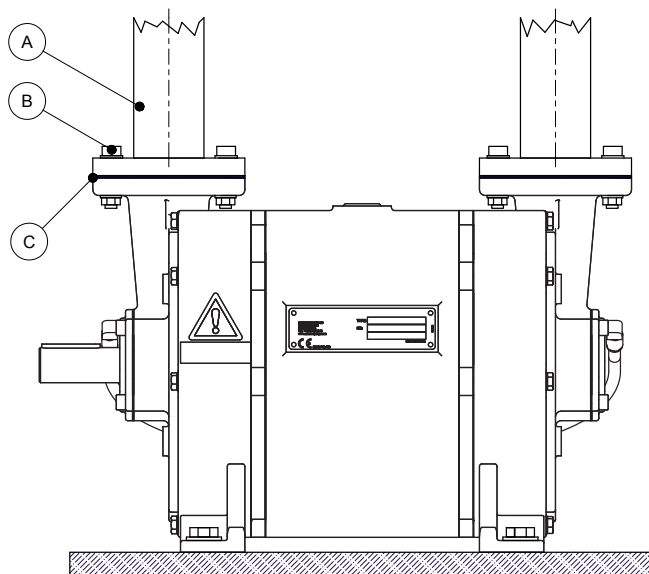


DOC1627290\_1A

---

### 4.3 Connecting the service liquid

The service liquid connection must be established on both ends of the pump to ensure optimal working conditions for the pump, and so that the mechanical shaft seals are lubricated by the service liquid.

A valve is to be mounted on the connection, which can open and close the service liquid supply independently of the pump.

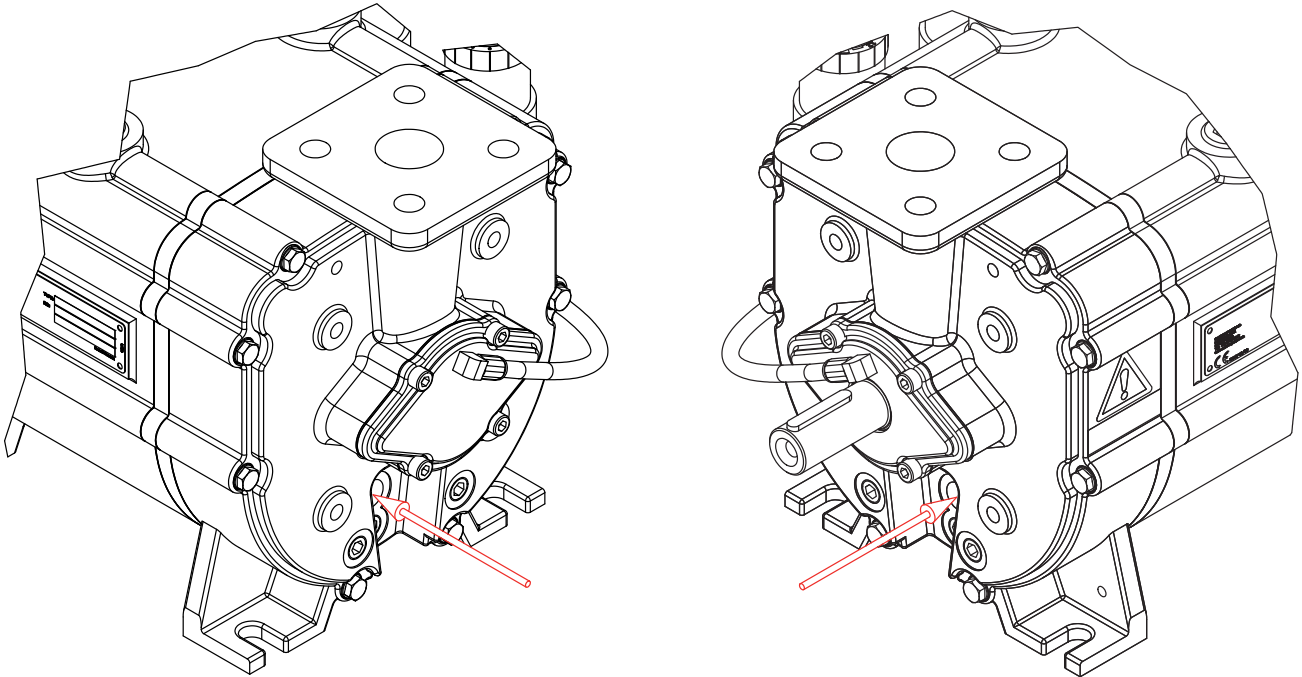

### 4.4 Transmission

The pump can be connected to direct or belt transmission. For belt transmission, it must be ensured that the permissible radial force is not exceeded. See specifications.

## 4.5 Prior to start-up



- Do not start the pump without service liquid, as this will damage the mechanical shaft seals.
- Do not start the pump if it is completely filled with service liquid.
- Do not start the pump before the grease cartridges have been activated, as this can damage the pump. (if equipped)
- Stop the pump immediately if the rotational direction does not correspond to the directional arrow.
- A failure to follow the above guidelines may result in damage to the pump.

### Activating the grease cartridges

Turn the knob on both grease cartridges clockwise to position 12.





## 4.6 Direction of rotation

Check the direction of rotation by briefly starting the pump.

The direction of rotation of the rotor must correspond to the direction arrow!

Below left, a right-side pump is shown which has a clockwise direction of rotation. (CW)

Below right, a left-side pump is shown which has a counter-clockwise direction of rotation. (CCW)

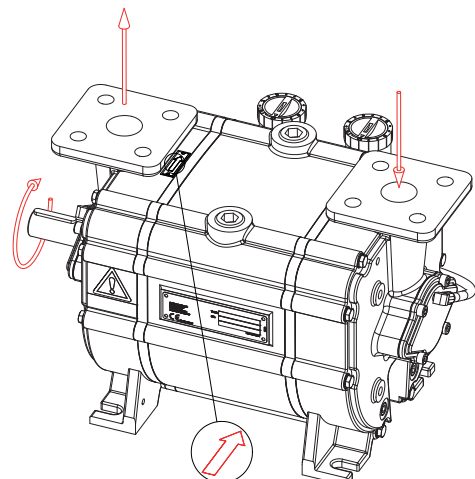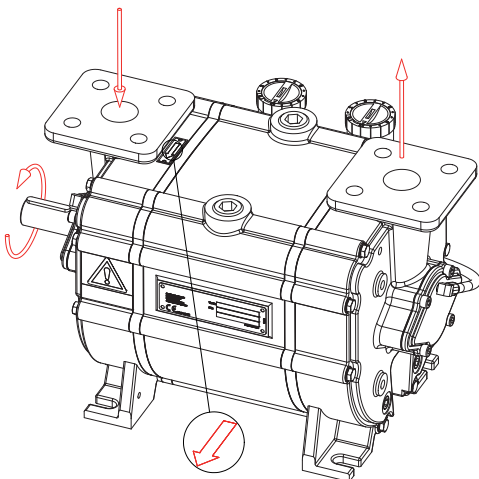

# 5 RECOMMENDED SERVICE, MAINTENANCE AND INSPECTION INTERVALS



A failure to observe the inspection intervals described in table below may result in damage to the pump.

Section	Operation	Interval
5.1	Drain liquid separator to remove contaminants	Weekly
5.2	Check grease cartridges (if equipped)	Weekly
5.3	Lubrication of bearings	Monthly
5.4	Inspection and cleaning of service liquid's supply pipe	Monthly

## 5.1 Draining the liquid separator

While the pump is stopped, the liquid separator must be drained to remove contaminants.

## 5.2 Check grease cartridges

If the pump is equipped with an automatic lubrication feature. It must be inspected and replaced as needed.

When the pump is commissioned for the first time, the cartridges must be activated by turning the arrow in the clockwise direction.

The cartridge is set to 12, which corresponds to an emptying time of 12 months. The cartridge must be replaced when empty.

It is only allowed to use automatic lubricator of type **LAGD 125/WA2**.



DOC3707


## 5.3 Lubrication of bearings



Over-lubrication of bearings may result in bearing failure! Do NOT exceed the amount of grease specified below!

The bearings must be lubricated with grease of type SKF LGWA2, once a month. It is recommended to lubricate the bearings while pump is running.

Pump	KL
Drive end (DE)	2 g/mth
Non drive end (NDE)	2 g/mth

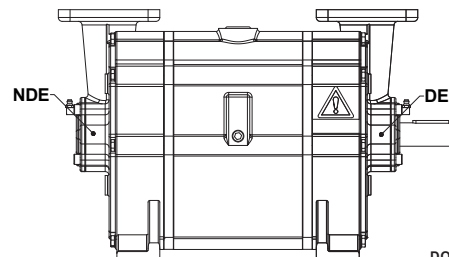

DOC1627287\_5


## 5.4 Inspection and cleaning of service liquid's supply pipe

The pipe connection between the liquid separator and pump must be inspected at least once a month, and any contaminants must be removed.


## 6 TROUBLESHOOTING

Problem	Cause	Effect	Corrective measure
<b>The pump is unable to create a vacuum</b>	<ul style="list-style-type: none"> <li>• The pump is not receiving enough service liquid</li> <li>• The temperature of the service liquid is too high</li> </ul>	<ul style="list-style-type: none"> <li>• Reduced output</li> <li>• The pump can become damaged during cavitation</li> </ul>	<ul style="list-style-type: none"> <li>• Check the liquid supply</li> <li>• Stop the pump and wait until the temperature has dropped to a sufficient level, or lower the temperature of the service liquid inlet.</li> </ul>
<b>Power consumption too high during operation</b>	<ul style="list-style-type: none"> <li>• The pump is receiving too much service liquid</li> </ul>	<ul style="list-style-type: none"> <li>• The pump can become worn</li> </ul>	<ul style="list-style-type: none"> <li>• Check the liquid supply</li> </ul>
<b>The start-up power is too high</b>	<ul style="list-style-type: none"> <li>• Too much service liquid in the pump prior to start-up</li> </ul>	<ul style="list-style-type: none"> <li>• Noise at start-up and possible overload of the power supply</li> </ul>	<ul style="list-style-type: none"> <li>• Check the stop valves in the liquid supply for leakage</li> </ul>
<b>Noise during operation</b>	<ul style="list-style-type: none"> <li>• Cavitation</li> </ul>	<ul style="list-style-type: none"> <li>• Severe damage to the pump and potential risk of breakdown</li> </ul>	<ul style="list-style-type: none"> <li>• Increase the suction pressure or lower the temperature of the service liquid</li> </ul>
<b>Leakage from the bearing housing's drain holes</b>	<ul style="list-style-type: none"> <li>• Damaged shaft seal</li> </ul>	<ul style="list-style-type: none"> <li>• Bearings may become damaged</li> <li>• Potential risk of explosive gas leak</li> </ul>	<ul style="list-style-type: none"> <li>• Stop the pump and contact the manufacturer</li> </ul>

# 7 SPARE PARTS

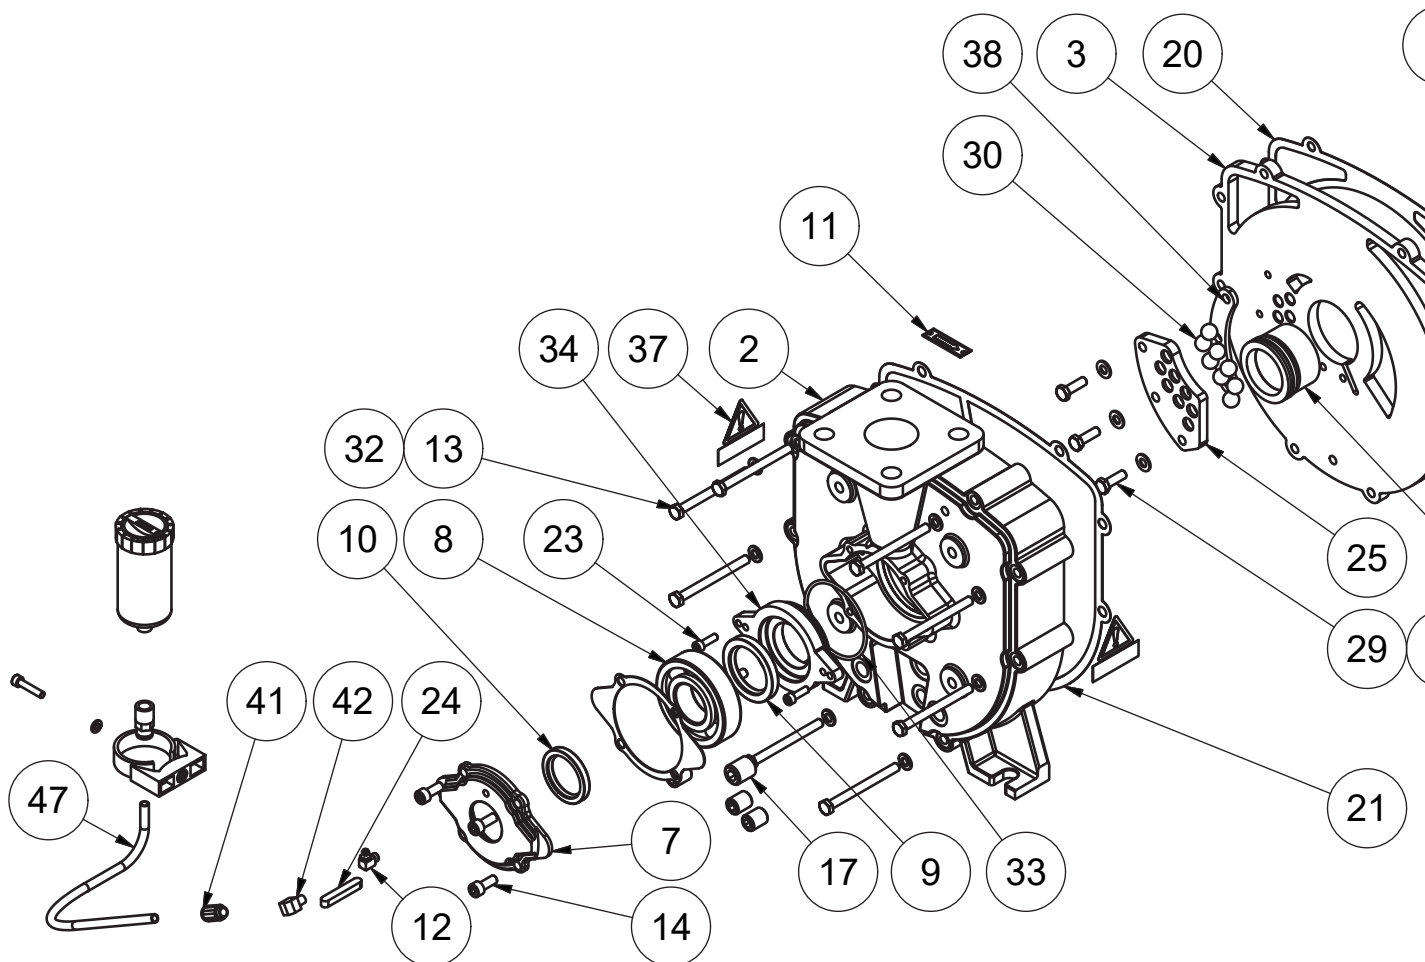



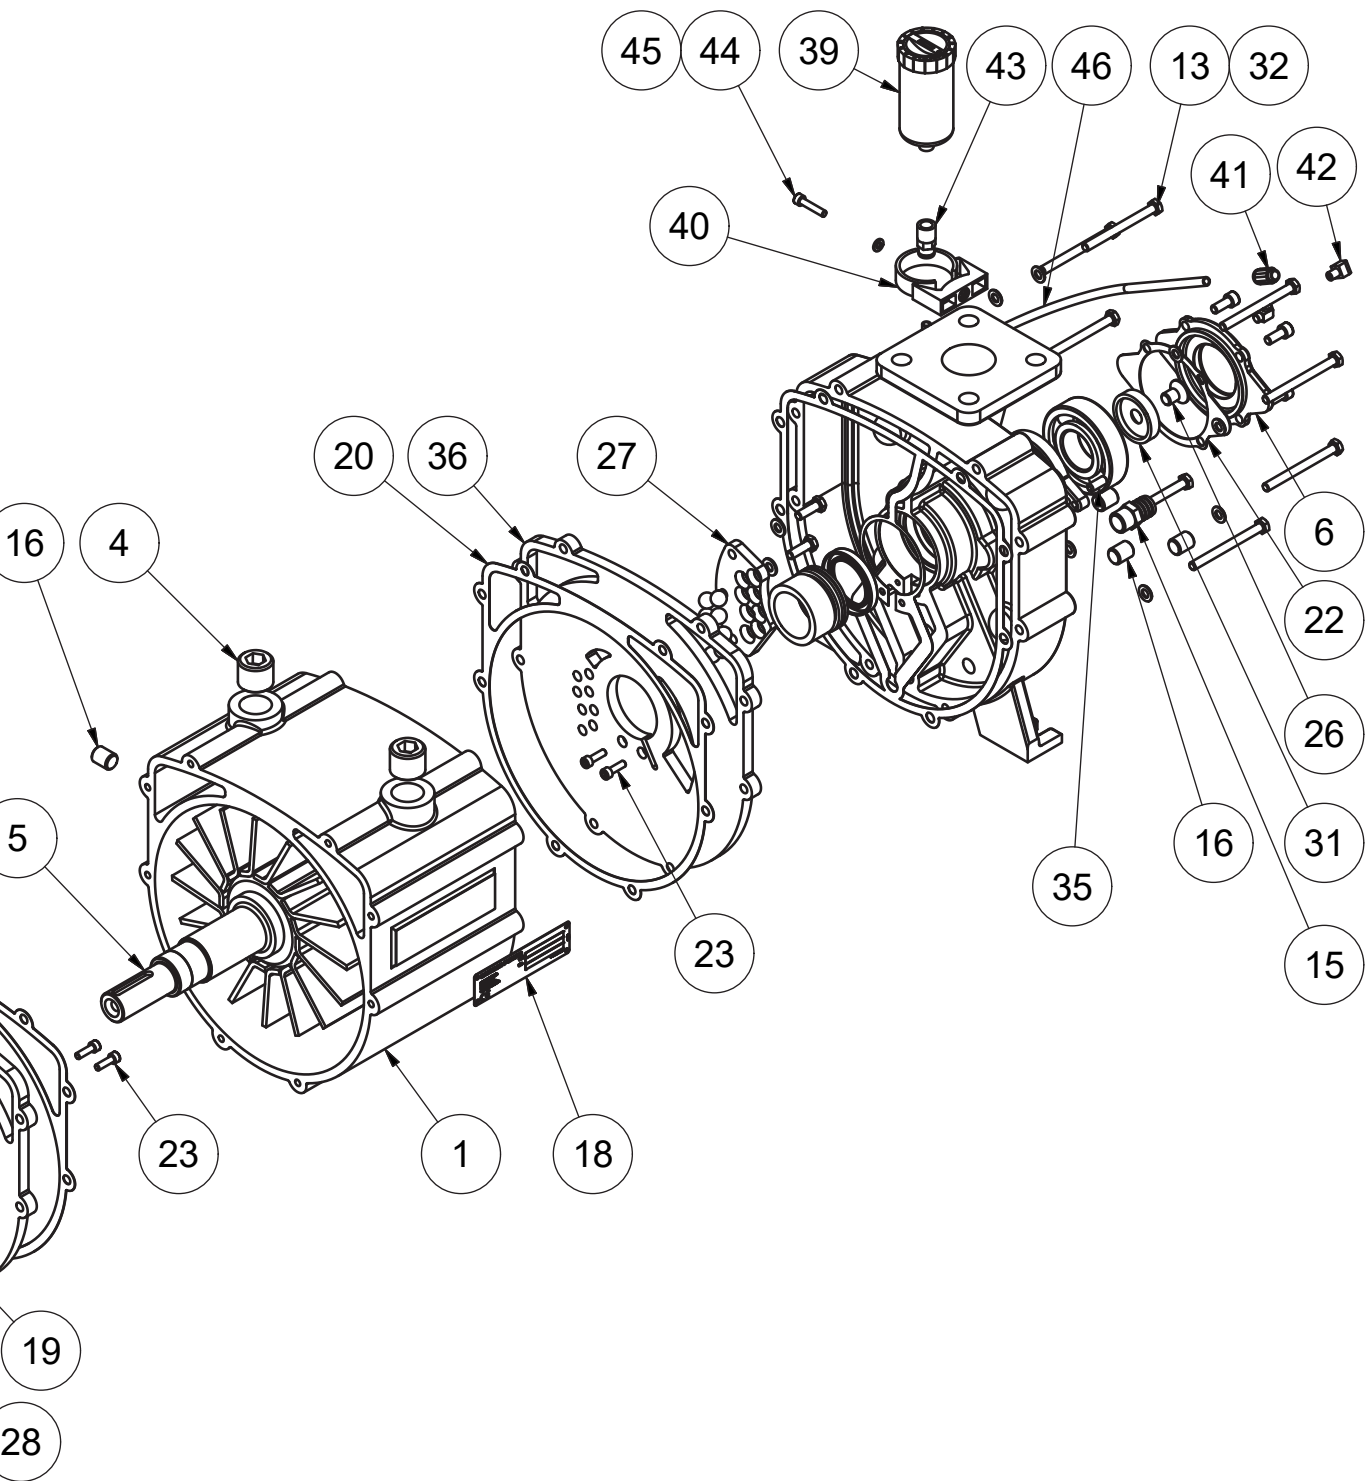

DOC1627341\_1

Pos.	Description	Qty.
1	Shell	1
2	Pump housing	2
3	Flow plate DE*	1
4	Plug 1"	2
5	Rotor*	1
6	Bearing cover NDE	1
7	Bearing cover DE	1
8	Ball bearing 6308 ø40/90x23	2
9	Radial shaft seal 45x65x08 DIN 3760A	2
10	Radial shaft seal 40x55X07 DIN 3760A	1
11	Direction arrow	1
12	Grease nipple M8x1,25 90° H3	2
13	M8x90 bolt DIN931 8.8FZB	16
14	M8x20 Allen screw DIN912 8.8FZB	8
15	Hose nipple 20 1/2" (1017-a)	1
16	Plug 3/8"	7
17	Plug 1/2"	1
18	Identification plate 35x125 mm*	1
19	Mechanical shaft seal NBR	2
20	Gasket Oakenstrong	2
21	Gasket Oakenstrong	2
22	Gasket rubber	2
23	M6x20 Allen screw DIN912	6
24	Parallel key 8x7x50 DIN6885A	1
25	Ball guide	1
26	M12x20 Allen screw 8.8 FZB	1
27	Ball guide	1
28	M8 Washer 8,4/16x1,6	6
29	M8x25 bolt DIN933	6
30	Valve ball Ø15	16
31	Washer	1
32	M8 washer 8,4/17x1,6	16
33	O-ring 75x3,0	2
34	Adjustment plate	2
35	M8x20 socket screw DIN 916	2
36	Flow plate NDE*	1
37	Sticker Warning!	2
38	Spacer for ball guide	2

\* -See section 1.3 for configuration of pump.

\*\*-Optional. Not equipped as standard.

Pos.	Description	Qty.
39	Automatic lubricator LAGD 125/WA2**	2
40	Clamp for automatic lubricator**	2
41	Push-in nipple ø8-M10x1 external thread**	2
42	Elbow 90deg M8x1,25k/M10x1**	2
43	Push-in nipple G1/4" internal thread**	2
44	M6x30 Allen screw DIN912	2
45	M6 washer 6,4/12,5x1,6	2
46	Hose Ø8/Ø6mm	0,4 m
47	Hose Ø8/Ø6mm	0,4 m

\* -See section 1.3 for configuration of pump.

\*\*-Optional. Not equipped as standard.



---

**Notes:**

---

---

**Notes:**

---

---

---

---

---

---

---

---

---

---

---

---

---

---

---

---

---

---

---

---

---

---

---

---

---

---

**Notes:**

---

---

---

---

---

---

---

---

---

---

---

---

---

---

---

---

---

## **SAMSON PUMPS**

Samson Pumps is the only company in the world to specialise exclusively in liquid ring vacuum pumps. Samson pumps are made in Denmark and used around the globe. We offer worldwide delivery, and we export to more than 80 countries around the world.

For over 40 years, our name has been synonymous with the strongest pumps for vacuum trucks and tankers. We constantly adapt our products to meet the changing needs of our customers. Today, it is not enough to simply produce a pump. Products must be refined so the customer can concentrate on what they do best. We therefore offer a wide range of standardised components that allow our customers to build vacuum systems without the need for specialist in-house expertise.

Strength and durability are our hallmarks! We have often heard from customers that our pumps are working in many years, and in most cases without the need for maintenance or repair. This emboldens us to say that we have the strongest program of pumps on the market.